


Newport County Propane
 50 Underwood Lane
 Middletown, RI 02842
 401-847-6878

Underground Propane Tank Installations

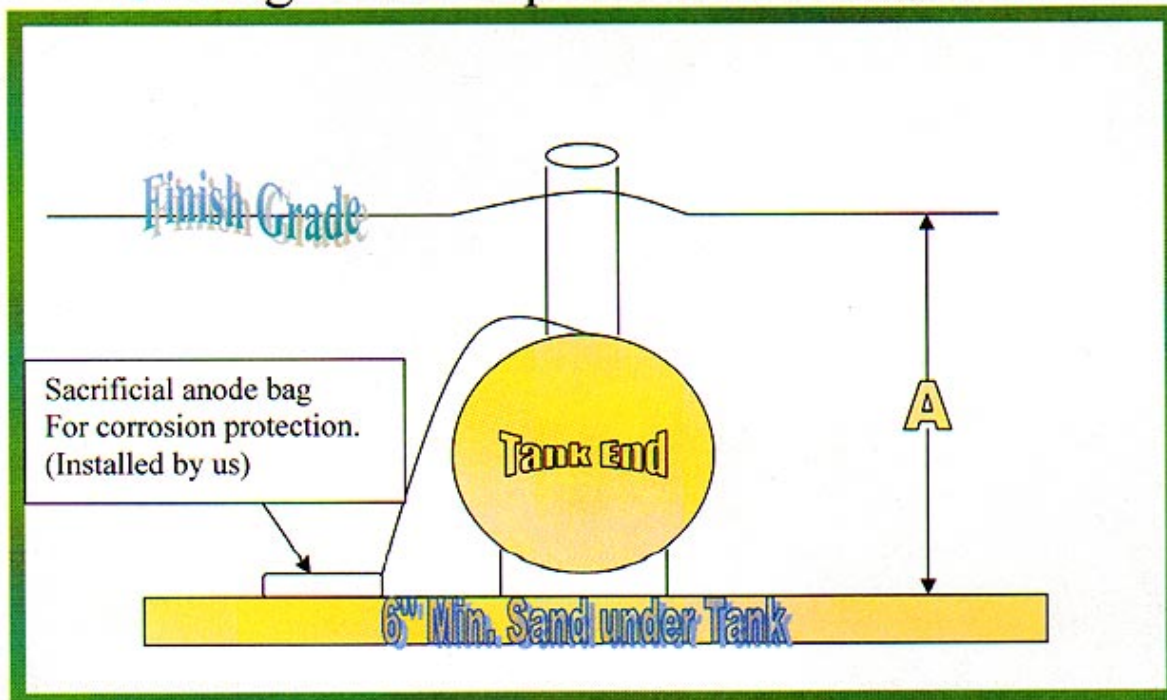

Tank Size	Dimension A	Hole Depth	Hole Width	Hole Length	Sand Needed
120 Gal	32"	38" Min	48"	8'	5 Yards
250 Gal	50"	54" Min	60"	10'	5 Yards
500 Gal	58"	64" Min	60"	12'	8 Yards
1000 Gal	64"	70" min	60"	20'	14 Yards

Additional Information:

- Sand must be used to backfill tank to at least 6" above tank for proper drainage.
- Extra sand is needed to surround underground gas line.
- No part of the tank can be located closer than 10' from a building, 10' from a property line, or 10' from sources of ignition, such as A/C compressors, Appliance Vents, Gas Grills, Etc...
- Ideally, a down pitch of the grade away from the dome will keep water out.
- Installing propane tanks underground is the preferred method of installation when considering safety, longevity, and aesthetics.
- A tracer wire is installed with the Plastic Underground Gas Line so that we can locate it in the future.