




Newport PROPANE

50 Underwood Lane Middletown, RI 02842
401.847.6878 phone 401.846.5540 fax

Underground Propane Tank Installations

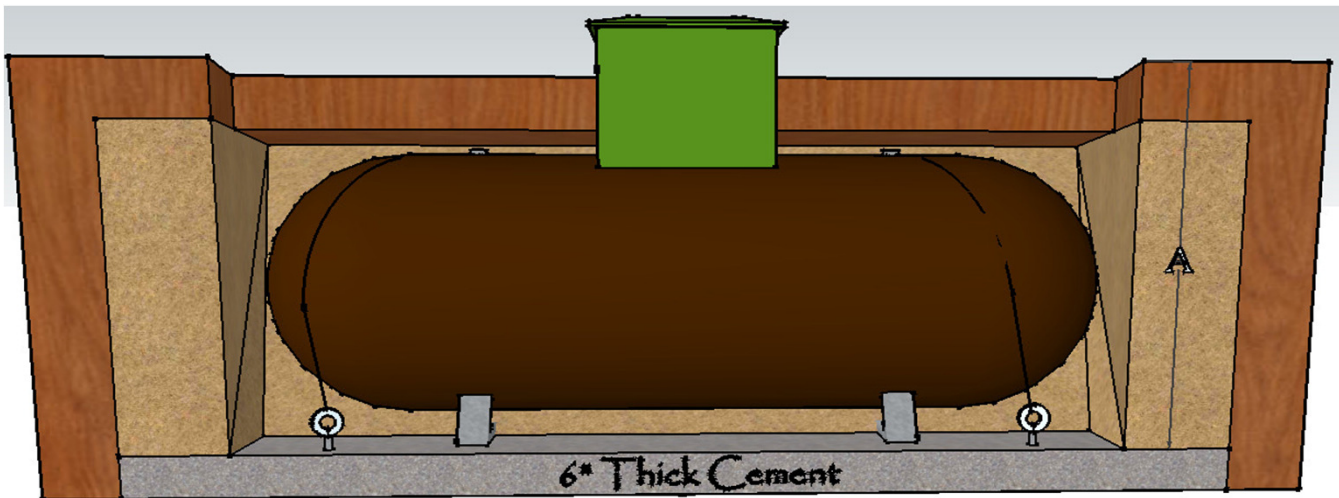

UG Tank Hole with 6" Cement				Cement for Above Ground Tanks Only				
Tank Size	Dim. "A"	Hole Width	Hole Length	Vertical Tanks				
120 Gal	32"	48"	8'	Tank Size	1 Tank	2 Tanks	3 Tanks	4 Tanks
250 Gal	48"	60"	10'	120 Gal	3' x 3' x 6"	3' x 6' x 6"	3' x 9' x 6"	3' x 12' x 6"
500 Gal	54"	60"	12'	Cement pad must extend 3' beyond structure				
1000 Gal	60"	60"	20'	Horizontal Tanks				
				120 Gal	6' long	3' wide	4" deep	
				250 Gal	9' long	4' wide	4" deep	
				500 Gal	12' long	4' wide	5.5" deep	
				1000 Gal	18' long	5' wide	6" deep	

Additional Information

- * Sand must be used to backfill tank to at least 8" above tank for proper drainage.
- * Extra sand is needed to surround underground gas line.
- * No part of the tank can be located closer than 10' from a building, property line or source of ignition. Such as A/C compressors, Appliance Vents, Gas Grills Etc...
- * Ideally, a down pitch of the grade away from the dome will keep water out.
- * In some jurisdictions, a concrete pad may be required to anchor tank down to.
- * A tracer wire is installed with the Plastic Underground Gas Line so that we can locate it in the future.